

ELECTRIC POWER CORPORATION

Level 5
Tuiatua Tupua Tamasese Efi
Building
Apia
Samoa



Telephone: (685) 65500
Facsimile: (685) 23 748
E-mail: info@epc.ws
Website: www.epc.ws
PO Box: 2011

March 16, 2018

To: BIDDERS

Subject: Supply of Equipment for Hydro Power Stations Communication and SCADA System Bid – SAMEPC 11/2018

Addendum No. 2


This Addendum No 2 informs bidders of change to bid closing date and requirements for antenna installation on side of building:

1. This serves to inform all bidders that the Closing date for all bids has changed. The new closing date and time is Monday 9th April 2018, at 10am.
2. Bidders must supply mountings and galvanized poles to mount the antennas at Tafitoala and Vailoa Hydro sites. The pole must be bolted to the side of the building using fabricated brackets or alternative to secure the pole/antenna. Height of antenna from the roof of Tafitoala building must be at least 2m, for Vailoa Building it must be at least 3m. Refer schematic drawing for details.

Please sign acknowledgement form below and return it.

Sincerely

Asolima Leapai
EPC Telecom Engineer
NCC, EPC

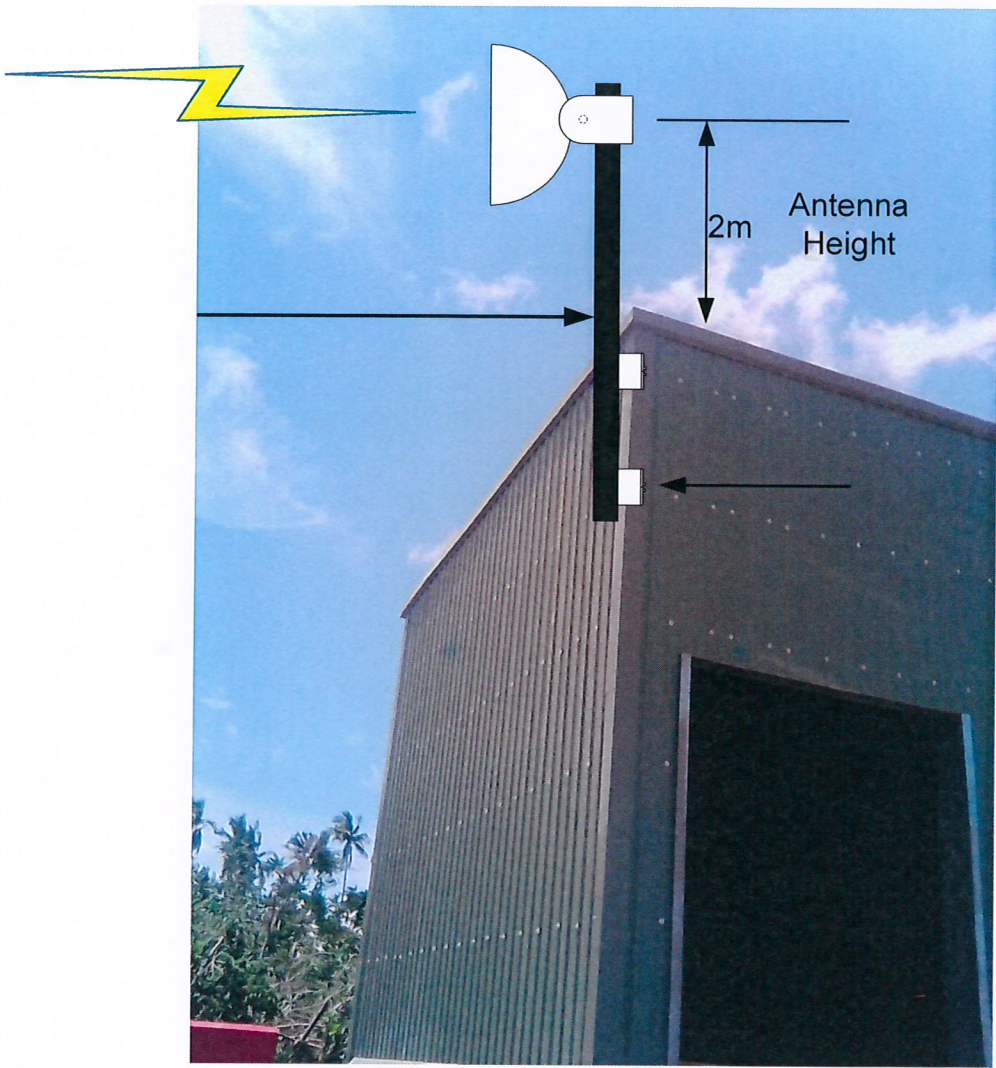

ACKNOWLEDGEMENT FORM

**Supply and Installation of Equipment for Hydro Stations Communication and
SCADA System Bid – SAMEPC 11/2018
ADDENDUM 2**

Bidder's Name: _____

We confirm receiving this Addendum No. 2

Signed by: _____

Authorized Person: _____

Title: _____

Copy: Chief Engineer NCC